

#### 4.0 TEST RESULTS

All the respective test results obtained are tabulated below and reflect our findings on 25 June 2004.

Please refer to Pages 3 to 10 of this report.

#### 4.1 Carbon Monoxide (CO)

Cumulative Time (mins)	CO (ppm)	MOM (PELTS) (ppm)	SIAQG (ppm)
0	0	25	9 (8-hr) 35 (1-hr)
5	152		
30	49		
60	17		
90	3		
120	1		
180	0		

**Remarks:** Carbon Monoxide (CO) was introduced into the indoor environment with Malboro type cigarettes burning for the first 5 minutes of test duration.

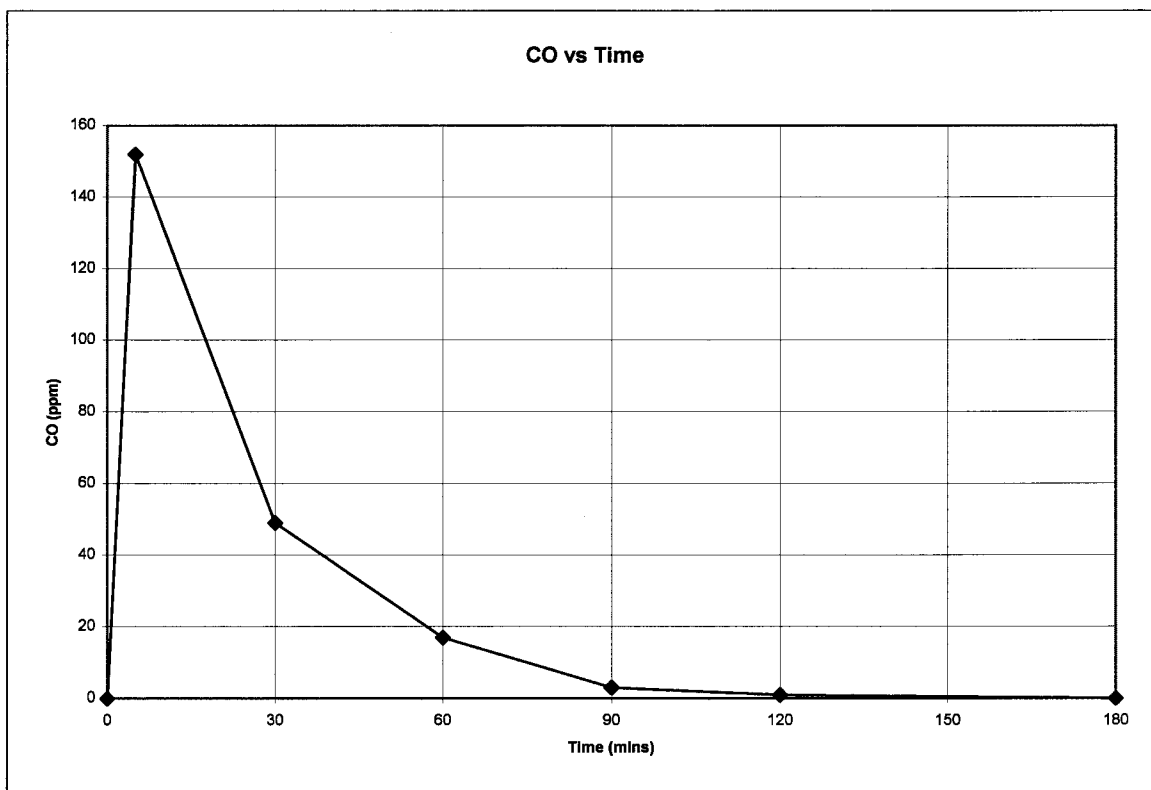


Figure 1: Graph of Carbon Monoxide Concentration versus Cumulative Time